



DUCT IDENTIFICATION

III. Grouping

- A. When identifying ducts between trunk line manholes, only the ducts connecting directly with other trunk line manholes shall be counted as trunk line ducts.

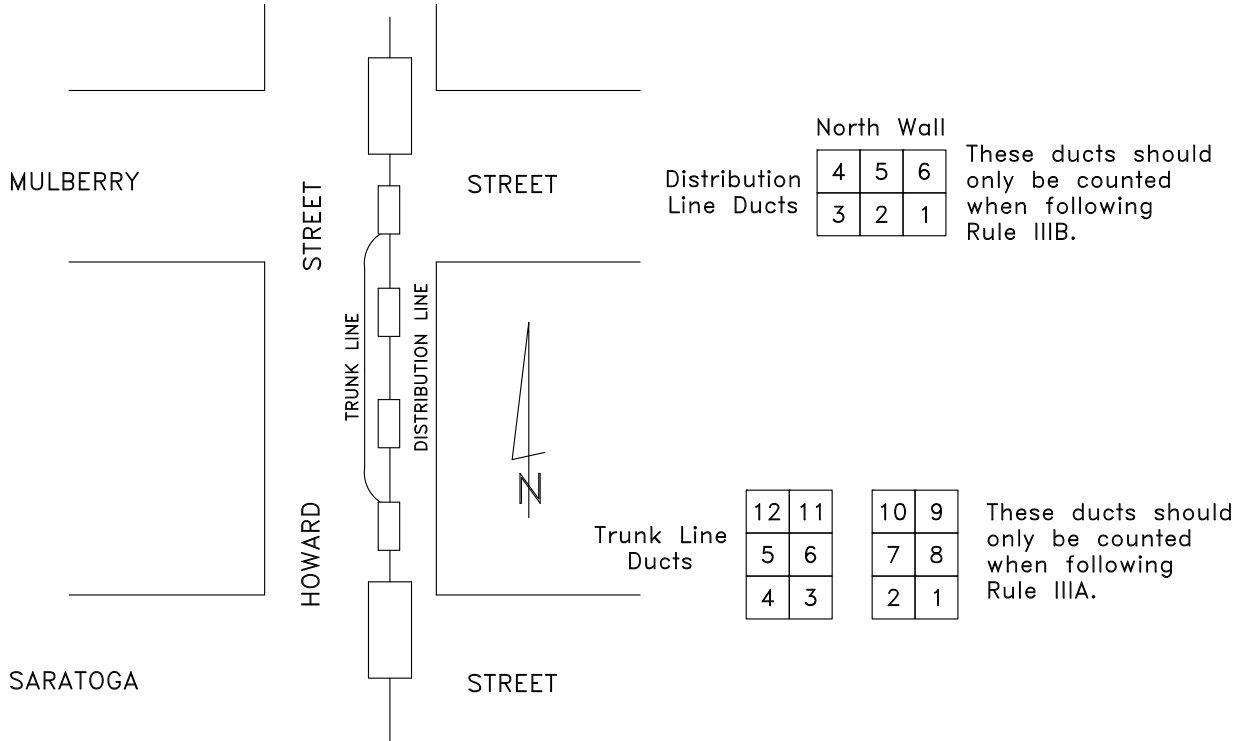

- B. When identifying ducts from a trunk line manhole to a distribution line manhole do not count trunk line ducts. See sketch under A above.
- C. If two duct groups leave a manhole on the same wall but connect with different manholes, each group shall be counted separately.

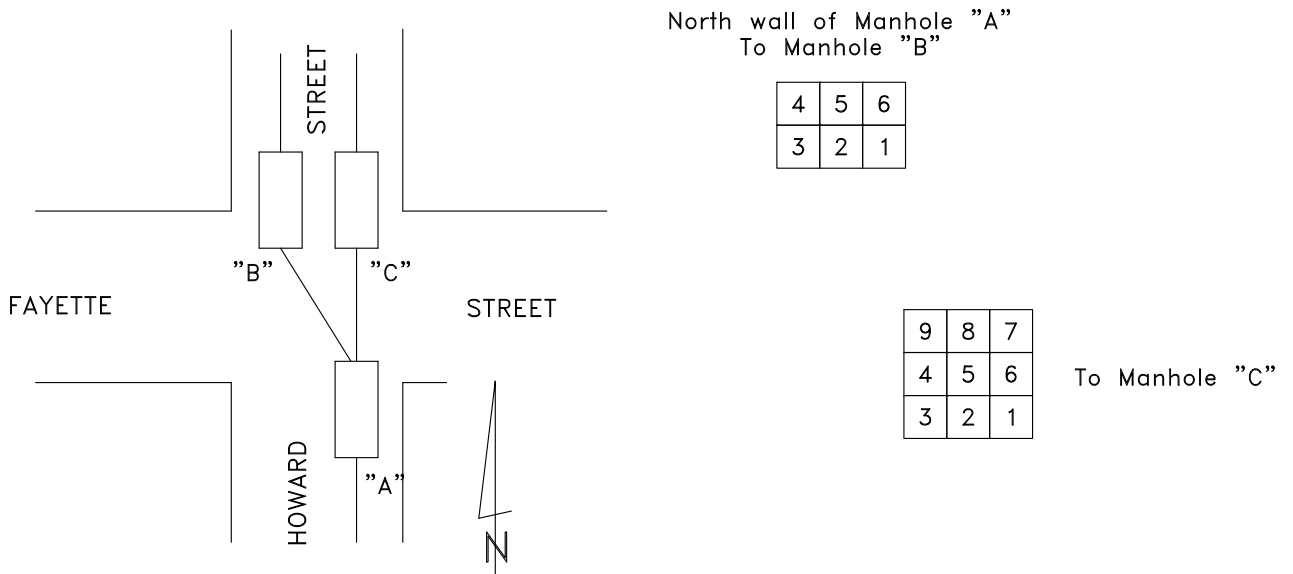

APPROVED:

Richard J. Baker
CHIEF, CONDUIT DIVISION

Khali Zane
DIRECTOR, DEPARTMENT OF TRANSPORTATION

**CITY OF BALTIMORE
DEPARTMENT OF TRANSPORTATION
CONDUIT DIVISION**

DUCT IDENTIFICATION

ISSUED	REVISED	REVISED
8 / 2010		

**STANDARD NO.
BC 830.01- 4**

SCALE : NONE SHEET 4 OF 6